



Colac Cement Products Pty Ltd

Drip feed irrigation examples for Envirosep SP2000 Treatment Plants

Example 1:

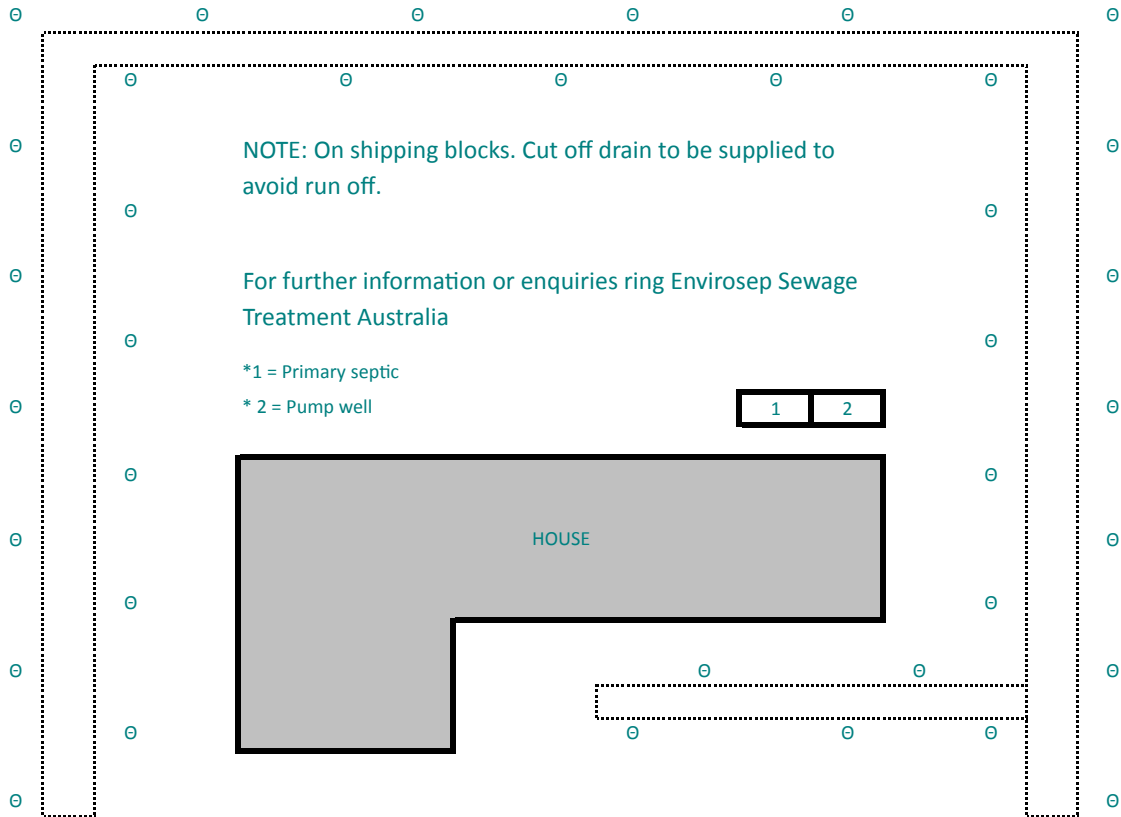

Example 2:

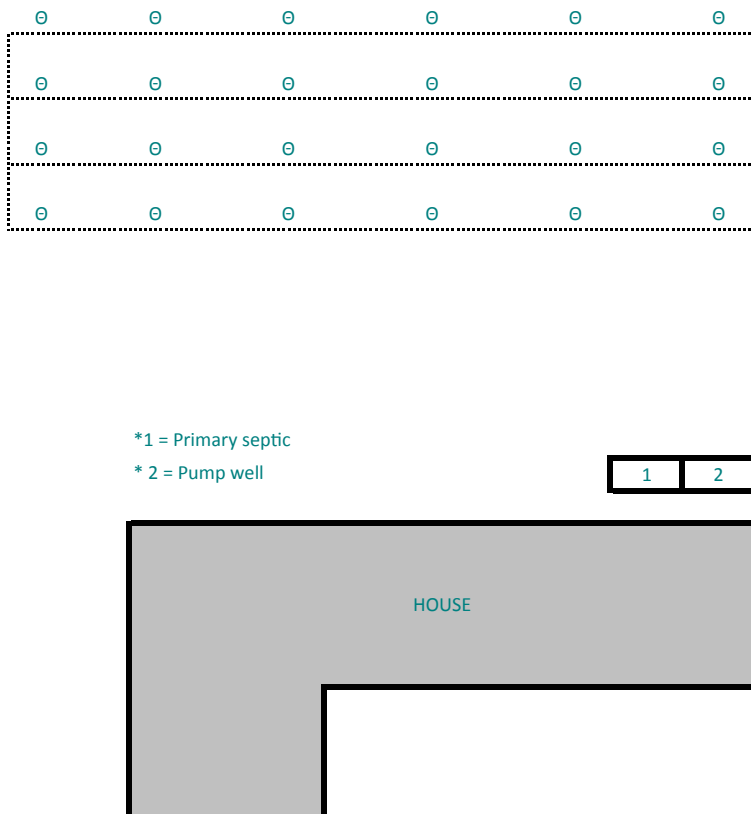

NOTES:

1. The Prepared Area must be a minimum of 2 metres off your boundary. Category 4, 200 to 300 sq metres required
2. Distribution Lines must be approximately 1.5 metres apart.
3. Tricklers must be approximately 1.5 metres apart. Suitable trees and shrubs to be planted.
4. The 25ml Poly pipe must be 100ml below surface, tricklers to be at ground level, and mulch to be spread over the prepared area.

This must comply to 1547 Australian Standards.